

## SIELCO SISTEMI srl

via Roma, 24 - 22070 Guanzate (CO) - Italy Tel: +39 031899671 – Fax: +39 031976966

e-mail: info@sielcosistemi.com website: http://www.sielcosistemi.com

## **FEATURES**

- Interface Ethernet 10/100 Base-T, Modbus TCP Server
- 8 isolated input channels in pairs
- Passive input up to ± 20 mA
- Integrated web server for acquiring the status of the analog inputs via browser
- Remotely programmable
- Connection by removable screw-terminals
- LED signalling for Link/Act Ethernet, power supply
- Galvanic isolation on all the ways
- EMC compliant CE mark
- In compliance to EN-50022 DIN rail mounting

# Modbus TCP/IP server 8 isolated in pairs inputs for mA

SS 8017-I





# **GENERAL DESCRIPTION**

The SS8017-I module is a Modbus TCP server unit that can convert up to 8 analog signals applied to the input in engineering units in digital format. The inputs can be connected with active current output sensors.

## The input channels are electrically isolated in pairs.

The device guarantees high accuracy and a stable measure versus time and temperature.

In order to ensure the safety plant, the device is provided with a Watch-Dog Timer system.

The Ethernet interface allows reading and writing in real time the values of the internal registers of the device.

The LEDs of signalling of Ethernet activity and power supply allow a direct monitoring of the system functionality.

The built-in Web Server of SS8017-I allows the remote visualization, acquisition of the analog inputs and the access to the main Ethernet programming parameters

The connection is made by removable screw-terminals (inputs and power supply) and RJ45 plug (Ethernet).

The device SS8017-I realizes a full electrical isolation between the lines, introducing a valid protection against the effects of all ground loops eventually existing in industrial applications.

The device is housed in a rough self-extinguishing plastic enclosure which, thanks to its thin profile of 22.5 mm only, allows a high density mounting on EN-50022 standard DIN rail.

## TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)

In compliance with Ethernet IEEE 802.3  Network interface Ethernet 10/100Base-T Modbus TCP			Input Accuracy (1) mA Linearity (1)	±0,05 % f.s.	POWER SUPPLY Power supply voltage Reverse polarity protec Consumption (standby Consumption (operativ	) 60 mA tip@ 24Vdc			
Max. cable length 100 meters Number of socket 16			mA	±0,1 % f.s.	Consumption (operative				
INPUT			Input impedance	~ 22 Ω	SOLATION				
Input Type			Thermal drift (1) Full Scale	± 0,01 %/°C	Power Supply / Ethernet 1500 Vac, 50 Hz, 1 min Inputs / Power supply 1500 Vac, 50 Hz, 1 min Inputs / Ethernet 1500 Vac, 50 Hz, 1 min 1500 Vac, 50 Hz, 1 min				
Current 20 mA	-20 mA	+20 mA	Sampling time (8 channels)	150 ms	Input / Input	1500 Vac, 50 Hz, 1 min			
					ENVIRONMENTAL CO Operative Temperature Storage Temperature Humidity (not condense Maximum Altitude Installation Category of installation Pollution Degree	-10°C +60°C -40°C +85°C ed) 0 90 % 2000 m Indoor			
					Inputs Re	-45 (on terminals side) movable screw-terminals movable screw-terminals			
					MECHANICAL SPECII Material Sel IP Code IP2 Wiring wird 0.8 Tightening Torque 0.8 Mounting in to	f-extinguish plastic			
(1) Referred to input Span (difference between max. and min. values)					,	nvironments ) 61000-6-2 61000-6-4			

## **INSTALLATION INSTRUCTIONS**

The device is suitable for fitting to DIN rails in the vertical position.

It is always a good thing to space the devices together 5mm. Make sure that sufficient air air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat. Install the device in a place without vibrations. It is also suggested to avoid routing conductors near power signal cables and to use shielded cables for connecting signals.

## **MODULE CONFIGURATION**

To configure the SS8000 series devices, it is necessary to enable the **INIT** mode. This mode allows you to access the device with the following default parameters :

IP Address:192.168.1.174 (DHCP disabled), or IP provided by DHCP (if enabled)
Modbus Address: 245

To enter the INIT mode follow these steps:

- Turn off the device;
- Connect the INIT terminal to the -V terminal as shown in figure.
- Turn on the device and connect with an internet browser to the device using the default parameters listed above and using the default login credentials:

Username: admin Password: admin

To exit INIT mode follow these steps:

- Turn off the device;
- Remove the INIT connection;
- Turn on the device and connect with the new parameters.

## **RESET FUNCTION- "P" BUTTON**

If it is necessary to restore the default device parameters, with device powered and not in INIT condition, push the front located "P" button for at least 5 seconds.

The green led PWR will switch-off, the yellow led STS will become orange and the reset of the device will occur. When the reset procedure will be finished, both the leds will set back to the default condition and the following parameters will be loaded:

#### Ethernet:

- IP Address: 192.168.1.100- Subnet Mask: 255.255.255.0- Gateway Mask: 192.168.1.1

Username: admin Password: admin

Modbus Address: 1

# **MAPPING MODBUS REGISTERS**

Register Position	Winlog Syntax	Description	Access		
40007	3:06	Node ID	R/W		
40011	3:10	System Flags	R/W		
40013	3:12	Watchdog timer	R/W		
40031	3:30	Input type Ch (1-0) *	R/W		
40032	3:31	Input type Ch (3-2) *	R/W		
40033	3:32	Input type Ch (5-4) *	R/W		
40034	3:33	Input type Ch (7-6) *	R/W		
40041	3:40	Analog Input (0) - Ch0	RO		
40042	3:41	Analog Input (1) - Ch1	RO		
40043	3:42	Analog Input (2) - Ch2	RO		
40044	3:43	Analog Input (3) - Ch3	RO		
40045	3:44	Analog Input (4) - Ch4	RO		
40046	3:45	Analog Input (5) - Ch5	RO		
40047	3:46	Analog Input (6) - Ch6	RO		
40048	3:47	Analog Input (7) - Ch7	RO		

* Input type Ch(BIT)	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Description	Input type Ch(n)**			**	Input type Ch(n-1)**											


** Input type Ch	Dec
Disabled	0
mA	3


# **LIGHT SIGNALLING**

LED	COLOR	STATUS	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered
		BLINK	Watchdog alarm
STS	YELLOW	OFF	Device in RUN mode
		BLINK	Device in INIT mode


## CONNECTIONS

### POWER SUPPLY





### ANALOG INPUTS

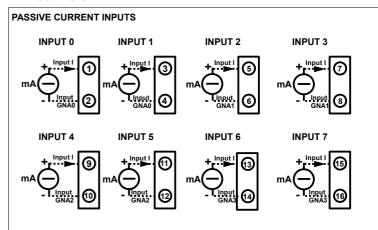

## NOTES:


Terminals "2" and "4" connected internally between them (neg. reference "GNA0"). Terminals "6" and "8" connected internally between them (neg. reference "GNA1"). Terminals "10" and "12" connected internally between them (neg. reference "GNA2"). Terminals "14" and "16" connected internally between them (neg. reference "GNA3").

The references "GNA0", "GNA1", "GNA2" and "GNA3" are isolated from each other.

## **ISOLATIONS STRUCTURE**



# **MECHANICAL DIMENSIONS (mm)**

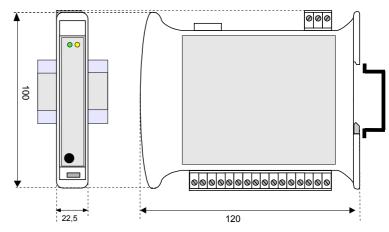

# **HOW TO ORDER**

" SS 8017-I "

Note: the device is provided with default configuration as:

IP address: 192.168.1.100 Modbus address: 1