

## SIELCO SISTEMI srl

via Roma, 24 - 22070 Guanzate (CO) – Italy Tel: +39 031899671 – Fax: +39 0313528682 e-mail: info@sielcosistemi.com website: http://www.sielcosistemi.com Distributed I/O Module 4 digital inputs + 4 relay outputs on RS-485 network

# FEATURES

- Field Bus data acquisition
- Master/Slave communication on RS-485 network
- MODBUS RTU/ASCII protocol or ASCII protocol
- 4 digital inputs
- 4 relay outputs (2 SPDT + 2 SPST)
- Watch-Dog alarm
- Four ways galvanic isolation 2000 Vac
- High accuracy
- EMC compliance CE Mark
- In compliance to EN-50022 DIN rail mounting



#### **GENERAL DESCRIPTION**

The device SS 3130 is able to acquire up to 4 digital inputs and to drive up to 4 relay outputs. The data are transmitted with MODBUS RTU/ASCII protocol on RS-485 network. To assure safe operation of the system, the device is equipped with two Watch-Dog timers: in case of alarm, the outputs are forced automatically on the safe

configuration. The 2000 Vac galvanic isolation between inputs, outputs, power supply and RS-485 serial line cancels any ground-loop effect noise, allowing the use of the device in worst ambient conditions.

The SS 3130 is in compliance to the 89/336/EEC directive on the electromagnetic compatibility.

The SS 3130 is housed in a rough self-extinguishing plastic enclosure of 22.5 mm thickness, suitable for EN 50022 standard DIN rail.

#### **COMMUNICATION PROTOCOLS**

On the SS3000 modules are implemented the following communication protocols:

MODBUS RTU/ASCII Protocol: one of the most used standard communication protocol; it permit to interface the modules of SS3000 series directly to the greater part of PLC and SCADA software available on the market. For communication setting, refer to the User manual.

#### **OPERATING INSTRUCTIONS**

Before to install the device, please read carefully the "Installation instructions" section.

If the correct configuration of the device is unknown, could be impossible to establish a communication with the device; connecting the INIT terminal to the GND terminal, when the devices is power-on, it goes automatically to the default configuration (see the Operating Manual).

Connect the power supply, the serial bus and the I/O signals as shown in the "Wiring" section.

The "PWR" LED, changes its state in function of the working condition of the device: please refer to the "Light signalling" to verify the correct working of the device.

To make easy the maintenance or the substitution of the device, it is possible the "hot swap" of the terminals.

## TECHNICAL SPECIFICATIONS (Typical @ 25 °C and under nominal conditions)

Digital Inputs		Power supply	
Channels	8	Supply Voltage Current consumption	
Input voltage (bipolar)		Reverse Polarity protection	60 Vdc max
OFF State		loolation voltage	
ON State	10 ÷ 30 V	Isolation voltage Inputs – RS485	2000 Vac 50 Hz, 1 min.
Impedance	4,7 ΚΩ	Inputs – Supply RS-485 – Supply	2000 Vac 50 Hz, 1 min. 2000 Vac 50 Hz, 1 min.
Digital Outputs		Temperature & Humidity	
Channels	4	<ul> <li>Operating Temperature</li> <li>Storage Temperature</li> <li>Non-condensing Humidity</li> </ul>	-10°C +60°C -40°C +85°C 0 90 %
Туре	n° 2 SPDT relays n° 2 SPST N.O. relays		090 %
Switching power (max.) 2 A @ 250 Vac ( resistive load ) per contact 2 A @ 30 Vdc ( resistive load ) per contact		Material Mounting Weight	self-extinguishing plastic EN-50022 DIN rail about 210 g.
Minimum load Max. Voltage	5Vdc , 10mA 250Vac (50 / 60 Hz) , 110Vdc	EMC Immunity	EN 61000-6-2
Sample time	<b>2</b> 0 ms	Emission	EN 61000-6-4
	ion (asynchronous serial) up to 115.2 Kbps 1,2 Km – 4000 ft.		

## **INSTALLATION INSTRUCTIONS**

The device SS 3130 is suitable to be mounted on DIN rail, in vertical position. For a correct working and a long life of the device, read the following indications.

# In case of the devices are mounted side by side, please leave about 5mm between in the following situations:

- Temperature in the cabinet higher than 45  $^\circ\text{C}$  and high supply voltage ( >27Vdc ).

Avoid to place raceways or other objects which could obstruct the ventilation slits. It is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel. Avoid to install the devices in a site where vibrations are present.

It is recommended to use shielded cable for connecting signals. The shield must be connected to an earth wire provided for this purpose. Moreover it is suggested to avoid routing conductors near power signal cables.

CABLING

DIGITAL INPUTS (4÷7)

POWER

SUPPLY

UNIT

INIT

0 8 4 5 9 7 8 6 6

RELAY OUTPUTS DIGITAL INPUTS (0+3)

000

< m ∪ ∩</li>

V+

00

ZOD

22249

00000

SHIELD


Dt

D


RS-485

# LIGHT SIGNALLING


LED	COLOUR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered or wrong RS-485 connection
		RAPID BLINK	Communication in progress (the blink frequency depends to the Baud-rate)
		SLOW BLINK	~1 sec Watch-Dog Alarm condition

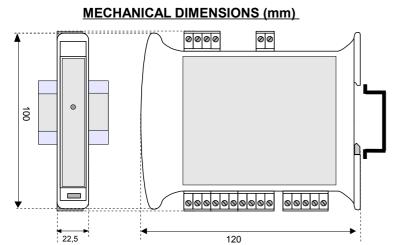


## **WIRING**

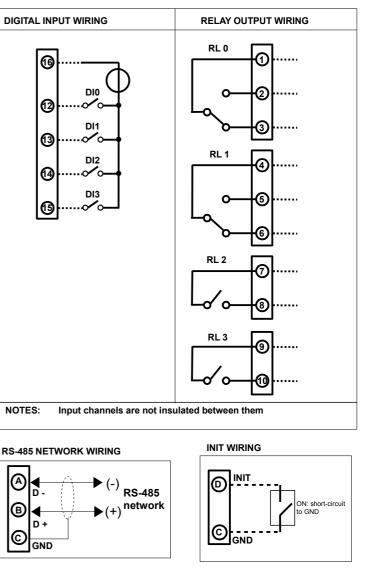

POWER SUPPLY WIRING



### **ISOLATION STRUCTURE**



## HOW TO ORDER

In the order phase it is mandatory to specify the protocol type (MODBUS or ASCII).

SS 3130 / M

Protocol type:
M: MODBUS.

= Mandatory

= Optional